
Infiltration Practices in Relation to a Drinking Water Supply Management Area

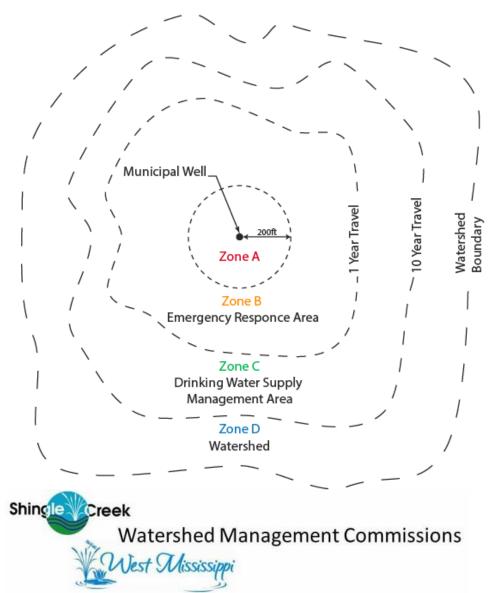

<u>Zone A</u>

Zone B

Zone C

No Infiltration Allowed Within 200 feet of a Municipal Well

Emergency Response Area (ERA) Infiltration Allowed With Filtration if Allowed By City Wellhead Protection Plan

Drinking Water Supply Management Area (DWSMA) Infiltration Allowed With Filtration

Zone D

Watershed

Infiltration Allowed With Filtration

Regardless of location, no infiltration is allowed in:

- Fueling and vehicle maintenance areas;
- Areas with less than 3 feet separation from the bottom of the infiltration system to the elevation of seasonal high groundwater;
- Areas with runoff from industrial, commercial and institutional parking lots and roads and residential arterial roads with less than 5 feet separation distance from the bottom of the infiltration system to the elevation of seasonal high groundwater;
- Sites containing contaminated soils or groundwater